


DESCRIPTION:

- 3 copper conductors
- Thermosetting conductor shield
- EPR insulation
- Thermosetting insulation shield
- Tape shield
- Copper ground wire
- PVC Jacket

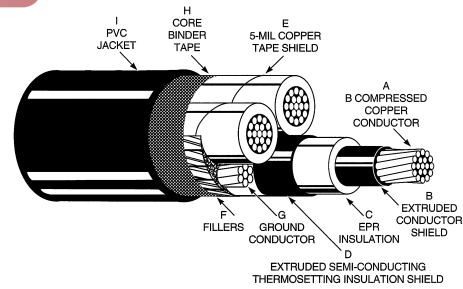

PWC Catalog #	Size	Conductor Diameter	Grd. Cond. Size AWG	Extruded Insulation Shield Diameter	Jacket Thickness	Approx. O.D.	Approx. Net Weight	Allowable Ampacities+	
	AWG or kcmil			inch	inch			inch	lbs./Mft.
03-0369	2	0.283	6	0.828	0.110	2.057	2252	160	165
03-0370	1	0.322	4	0.868	0.110	2.143	2566	185	185
03-0371	1/0	0.362	4	0.908	0.110	2.229	2881	210	215
03-0372	2/0	0.405	4	0.948	0.110	2.316	3244	235	245
03-0373	3/0	0.456	3	0.998	0.110	2.424	3724	270	280
03-0374	4/0	0.512	3	1.053	0.110	2.543	4283	305	320
03-0375	250	0.558	3	1.108	0.140	2.673	4807	335	350
03-0376	350	0.661	2	1.213	0.140	2.953	6232	400	430
03-0377	500	0.790	1	1.338	0.140	3.223	8056	485	525

+Ampacities are based on the NEC 1999 Edition. Duct ampacities are based on Table 310-79 three conductors within an overall covering in one underground duct, 105°C conductor, 20°C earth ambient temperature. Conduit in air ampacities are based on Table 310-75 three cables within an overall covering in isolated conduit in air, 105°C conductor, 40°C ambient temperature.

15kV Type MV-105 CABLE CONSTRUCTION

Conductor	The conductor shall be Class B compressed concentric stranded bare copper in accordance with ASTM B3 and B8 and ICEA Part 2, Section 2.1 and 2.5.
Conductor Shield	The conductor shall be shielded with an extruded semi-conducting thermosetting polymeric layer, which shall be firmly bonded to the insulation. The thickness shall be in accordance with the referenced standards.
Insulation	The insulation shall be EPR (ethylene propylene rubber) meeting the requirements of the referenced standards. The average thickness shall be 0.220" and the minimum spot thickness shall be not less than 90% of the average thickness.
Insulation Shield	The insulation shall be shielded with an extruded semi-conducting thermosetting polymeric layer which shall be identified as semi-conducting. Over this layer shall be applied a helically wrapped 5-mil copper tape.
Grounding Conductor	The ground conductor shall be Class B compressed concentric stranded bare copper in accordance with ASTM B3 and B8.
Assembly	The insulated and shielded power conductors shall be cabled round with fillers and with a grounding conductor in one outer interstice and covered with a binder tape.
Jacket	The cable shall be covered with a black PVC jacket conforming to the requirements specified for polyvinyl chloride in ICEA. The average thickness shall be in accordance with the referenced standards and the minimum spot thickness shall be not less than 80% of the average thickness. The jacket will be sunlight resistant and will meet the requirements of the IEEE 1202.

APPLICATIONS:

- Aerial installations
- Direct buried
- Metal racks
- Open trays
- Troughs or raceway

These cables are capable of operating continuously at maximum conductor temperature of 105°C for normal operation, 140°C for emergency overload conditions, and 250°C for short circuit conditions, and are rated at 15,000V, 133% insulation level (ungrounded system).

SCOPE:

This specification covers three conductor EPR (ethylene propylene rubber) insulated, shielded, thermoplastic jacketed power cables with grounding conductor for use in aerial installations, metal racks, open trays, troughs, or continuous rigid cable supports. These cables are capable of operating continuously at a temperature of 105°C for normal operations, 140°C for emergency overload conditions, and 250°C for short circuit conditions, and are rated at 15,000V, 133% insulation level (ungrounded system).

SPECIFICATIONS:

Manufactured and tested in accordance with the latest revisions of ICEA Pub. No. S-68-516, NEMA Pub. No. WC8, AEIC No. 6, and UL 1072.

